

Declaration of test results

2011-Efectis-R9164h-D

Efectis Nederland BV hereby declares that

Non Ignis - Spruce (*Picea abies*),
pressure treated with **Magma Firestop® SBP-1**
and coated with **InnoShield DRF**

has been tested by Efectis Nederland BV according to:

EN 13823 and EN 11925-2
“Reaction to fire tests for building products -
Building products, excluding floorings,
exposed to the thermal attack by a single burning item”
and
“Ignitability of products subjected to direct impingement of flame”

According to the classification standard EN 13501-1 the product is classified as:

B -s2, d0

The complete details of the test performed, the results and the field of application are recorded in Efectis test reports 2011-Efectis-R9164f and R9164g and classification report 2011-Efectis-R9164h.

This declaration is valid until:

November 2017


This declaration is issued to:

Magma Industries
Markweg Zuid 27
NL-4794 SN HEIJNINGEN
The Netherlands

Place and date:

Rijswijk, 27th November 2012

On behalf of Efectis Nederland BV:

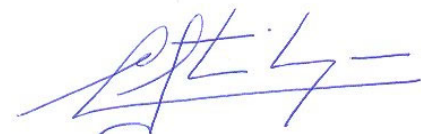

C.C.M. Steinhage, B.Sc.
Project Leader Reaction to Fire
